


## SBS Details: D1.7.6-3 Curbs & Sleepers (Basic Curb)

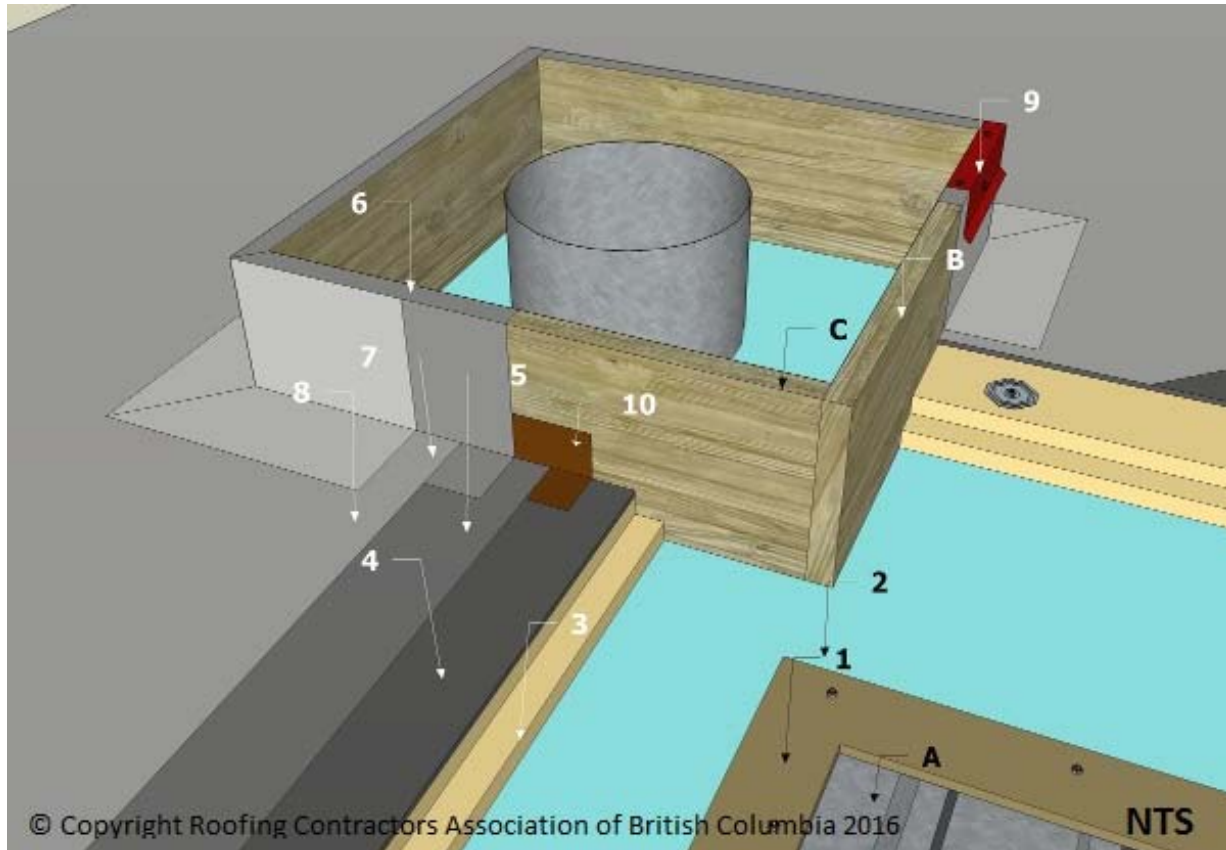

**Notice to reader:** Drawing for illustration purposes only. Consult the RoofStar Guarantee Standards for more information.

### 1 WORK INCLUDED

(1) [Gypsum Deck Overlay](#)

Required when insulation is too thin to span flutes of steel decking or when required as thermal barrier by design authority.

(2) [Vapour Retarder](#)

If required by design authority.

(3) [Insulation](#)

Mechanically fastened. See available insulation products in the [Accepted Materials](#) section of this Manual.

(4) [Insulation Overlay Board](#)

Asphalt adhered or mechanically fastened. Two layers required over heat-sensitive insulation.

(5) **Base Sheet**

Adhered to overlay board using asphalt, cold adhesive, self-adhered, mechanical attachment or torch applied according to manufacturer's specification and to *RGC Guarantee Standards*. Torching directly to wood surfaces is not permitted.

(6) **Base Sheet Flashing**

Adhered according to manufacturer's specifications, using cold adhesive, self-adhered, or torch applied to cover boards, or mechanically attached membrane. Torching directly to wood surfaces is not permitted.

(7) **Cap Sheet**

Applied according to manufacturer's printed instructions and to *RoofStar Guarantee Standards*.

(8) **Cap Sheet Flashing**

Applied according to manufacturer's printed instructions and to *RoofStar Guarantee Standards* to top of curb.

(9) **Metal Flashing**

As required by *RoofStar Guarantee Standards*.

(10) **Fire-stop Tape**

Recommended.

---

## 2 RELATED WORK BY OTHERS

(A) **Acceptable Deck**

(B) **Air / Vapour Seal**

(C) **Wood Blocking**

Minimum 200 mm (8") in height. (See asphalt adhered or mechanically fastened. Two layers required over heat-sensitive insulation. Cant is optional).