

Document Number:	PUB-DRU-292373
Publication Date:	2014-12-02
Revised:	2015-04-22
Revaluation Date:	2017-12-02

Supplier:



Built up membrane RETROPLUS asphalt adhered system, Partially Attached Roofing System (PARS)

Roofing System Summary :

- membrane: Felt Membrane with gravel on surface
- Coverboard: Wood fiber board
- Insulation: Polyisocyanurate or allowable products
- Vapour barrier: Self-adhering membrane
- Thermal barrier: Optional
- Decking: Steel deck
- Dynamic Uplift Resistance (DUR) as per CSA A123.21:

Description	Test observation reading	With SF of 1.5
System A	-3.6 kPa (-75 psf)	-2.4 kPa (-50 psf)

Notes :

Allow products:

Only equivalent products included into the roofing system's report are admissible.

Optional components:

Components of the roofing system designated as optional may be included or excluded from the roofing system which will not change the published dynamic uplift resistance (DUR).

Safety factor:

As required by in the CSA A123.21 Standard, the published dynamic uplift resistance (DUR) are reduced by a safety factor of 1.5 (SF of 1.5)

Admissible wind uplift load calculation:

An online calculator is available at www.sigders.ca. The user will have to provide the following information:

- building location;
- building geometry;
- building exposure;
- building openings;
- building importance factor.

The calculator will display the allowable design load of the roof's field surface, edges and corners as well as the dimensions of the edge and corner zones.

Technical Advisories:

Assessment reports must be read in conjunction with technical advisories issued by **exp** Services Inc.

Values

For this document, the metric values are the standard and values in parentheses are for information only.

Notice

Exp Services inc. reserve their right to withdraw, without prior notice, the test report performed as per CSA A123.21 Standard.



Roof System Assessment Report of Wind Uplift Resistance (ISO 17025)

Document Number:	PUB-DRU-292373
Publication Date:	2014-12-02
Revised:	2015-04-22
Revaluation Date:	2017-12-02

Roofing System's Specific Data:

Surface:		
- Allowable product:	Generic	
-	Gravel	
Adhered Attached Pattern	Adhesion mode	Adhesive spacing
For System A result	Fully adhered	No spacing
- Attachment type:	Asphalt type III	
- Attachment supplier:	Butimar	

Membrane:		
- Allowable product:	Johns Manville	
-	GlasPly IV	
Adhered Attached Pattern	Adhesion mode	Adhesive spacing
For System A result	Fully adhered	No spacing
- Attachment type:	Asphalt type III	
- Attachment supplier:	Butimar	


Cover board:		
- Allowable product:	Johns Manville	
-	RETROPLUS	
- Allowable thickness:	12,7 mm (½ in)	
Adhered Attached Pattern	Adhesion mode	Adhesive spacing
For System A result	Fully adhered (4'x 4' panel)	No spacing
- Attachment type:	Asphalt type III	
- Attachment supplier:	Butimar	

Insulation Second row:			
- Allowable products:	Johns Manville		
-	ENRGY 3	ENRGY 3 AGF	ENRGY 3 CGF
-	ENRGY 3 .E	ENRGY 3 FR	
- Allowable thickness:	Up to 203 mm (8 in)		
Adhered Attached Pattern	Adhesion mode	Adhesive spacing	
For System A result	Fully adhered (4'x 4' panel)	No spacing	
- Attachment type:	Asphalt type III		
- Attachment supplier:	Butimar		

Insulation First row:			
- Allowable products:	Johns Manville		
-	ENRGY 3	ENRGY 3 AGF	ENRGY 3 CGF
-	ENRGY 3 .E	ENRGY 3 FR	
- Allowable thickness:	Up to 203 mm (8 in)		
Mechanically attached Pattern	Row spacing	Fasteners spacing	
for System A result	8 fasteners and plates per panel 32sq²	As Mechanically pattern drawing	
- Attachment type:	Ultrafast fasteners #12 60 mm (2 ¼ in) & Ultrafast square plates 76 mm (3 in)		
- Pullout fastener resistance:	151 psi or 413 lbf or 1837 Newton		
- Attachment supplier:	Johns Manville		

Roof System Assessment Report of Wind Uplift Resistance (ISO 17025)

Document Number:	PUB-DRU-292373
Publication Date:	2014-12-02
Revised:	2015-04-22
Revaluation Date:	2017-12-02

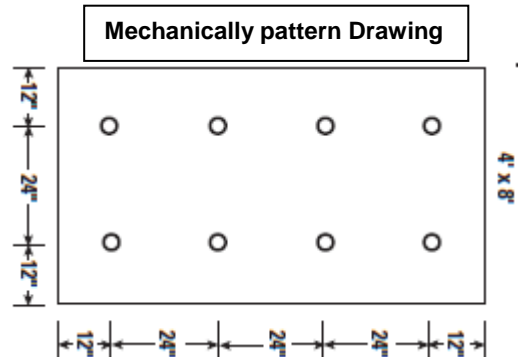

Vapour Barrier:		
- Allowable product:	Johns Manville	
	JM Vapor barrier SA	
Adhered Attached Pattern	Adhesion mode	Adhesive spacing
For System A result	Fully adhered	No spacing
- Attachment type:	Self-adhering membrane	

Thermal Barrier (optional): *See optional products table*

Decking:	
- Type:	Galvanized construction steel or coated with an aluminum/zinc alloy or PVC in accordance with ASTM A653, ASTM A792, ASTM A1008 or CSSBI 10M Standards.
- Supplier:	Generic
- Thickness:	0.76 mm (0.03 in.) minimum, with a yield strength of 230 MPa (33 ksi) and a tensile strength of 310 MPa (45 ksi) commonly defined as being of a 22 gauge minimum thickness.
- Attachment method:	The deck's fastening to the supporting structure must be strong enough to resist wind uplift loads (adjusted as per NBC requirements).
- Fastening uplift resistance (CSA S136.F04):	2.09 kN (470 pf)
- Equivalence:	Steel deck thickness of 18 to 22 gauges or wood deck or concrete deck with pullout resistance equal or higher than the Fastening uplift resistance specified above.

Optional Products Table:

Thermal barrier:		
- Allowable product:	CGC / USG	
	Securock Gypsum Fiber Roof Board	
- Allowable thickness:	12.7 mm (1/2 in)	
- Attachment mode:	Loose laid, adhered or mechanically attached	