



NEMO|etc.

353 Christian Street, Unit #13
Oxford, CT 06478
(203) 262-9245

ENGINEER

EVALUATE

TEST

CONSULT

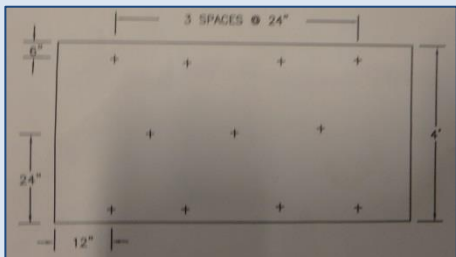
CERTIFY

**ROOF SYSTEM ASSESSMENT REPORT
DYNAMIC UPLIFT RESISTANCE PER CSA A123.21**

CLIENT:	The Garland Company	TEST DATE:	2018-01-10
DOCUMENT NO.	GRL-PARS-1.2	PUBLICATION DATE:	2018-02-27
TEST PANEL NO.	GRL-D2.1	REVISION NO.	R0
SYSTEM TYPE:	B	REEVALUATION DATE:	2021-02-28

PARTIALLY ADHERED ROOFING SYSTEM (PARS) SUMMARY

PERFORMANCE⇒	PASSING PRESSURE	WIND UPLIFT RESISTANCE (with SF of 1.5)
	3.3 kPa (69 psf)	2.2 kPa (46 psf)

COMPONENT	ALLOWABLE PRODUCTS		BY
CAP PLY⇒	StressPly, StressPly Mineral, StressPly FR Mineral, StressPly E, StressPly E Mineral, StressPly E FR Mineral, StressPly EUV, StressPly EUV Mineral, StressPly EUV FR Mineral, StressPly Plus, StressPly Plus Mineral, StressPly Plus FR Mineral, VersiPly 60, VersiPly 80 or VersiPly Mineral, BiFlex Cap, BiFlex Cap Mineral, OptiMax or OptiMax FR Mineral		Garland
ATTACHMENT:	hot asphalt at 25-30 lbs/square		
BASE PLY⇒	StressBase 80, StressBase 120, FlexBase 80, FlexBase 120, FlexBase Plus 80, FlexBase Plus 120, FlexBase E 80 or FlexBase E 120		Garland
ATTACHMENT:	hot asphalt at 25-30 lbs/square		
INSULATION, TOP LAYER⇒	Min. 0.5" SECUROCK Gypsum-Fiber Roof Board		U.S. Gypsum
ATTACHMENT:	hot asphalt	25-30 lbs/square	generic
INSULATION, BASE LAYER⇒	One or more layers; top layer min. 2" thick		
	ACFoam II		Atlas Roofing
	H-Shield		Hunter Panels
	ENRGY 3		Johns Manville
ATTACHMENT:	1 per 2.9 ft ² (11 parts per 4x8 ft board)		
		Dekfast #14 with Dekfast Galvalume Steel Hex Plate	SFS Intec
		OMG Roofgrip #14 with OMG 3 in. Galvalume Steel Plate or OMG AccuTrac Plate	OMG
		TRUFAST #14 HD with TRUFAST 3" Metal Insulation Plate	Altenloh, Brinck & Co.
VAPOUR BARRIER⇒	Grip-Rite Titan™ LD or other kraft-paper or polyethylene film		Various
ATTACHMENT:	loose-laid		

ROOF SYSTEM ASSESSMENT REPORT, DYNAMIC UPLIFT RESISTANCE PER CSA A123.21

CLIENT:	The Garland Company	PUBLICATION DATE:	2018-02-27
DOCUMENT NO.	GRL-PARS-1.2	REVISION NO.	R0
TEST PANEL NO.	GRL-D2.1	REEVALUATION DATE:	2021-02-27

Page 2 of 2

**NEMO|etc.**

COMPONENT	ALLOWABLE PRODUCTS	BY
THERMAL BARRIER⇒	(Optional) Thermal barrier of any specified type or thickness	Various
ATTACHMENT:	loose-laid, adhered or mechanically attached	
DECK⇒	Minimum 22 ga. type B steel meeting ASTM A653, A792, A1008 or CSSBI 10M standards and having a yield strength of 40 ksi (275 MPa), or alternate steel deck providing the fastener withdrawal resistance noted below	Various
FASTENER POINT-LOAD⇒	885 N (199 lbf)	

END OF REPORT